


DUCTILE IRON PIPE FOR ONE STANDARD PIPE JOINT LENGTH PAST UPPER BEND OR DUCTILE IRON PIPE IS TO NEXT FITTING WHICH EVER IS SHORTER (TYP.)



NOTES:

1. ALL DUCTILE IRON PIPE AND FITTINGS SHALL BE WRAPPED WITH MINIMUM 8 MIL POLYETHYLENE (BLACK POLY) AND OPEN ENDS/SEAMS SEALED WITH DUCT TAPE.
2. ALL FITTINGS SHALL HAVE RESTRAINED JOINTS AND BLOCKED WITH CONCRETE BLOCKING.

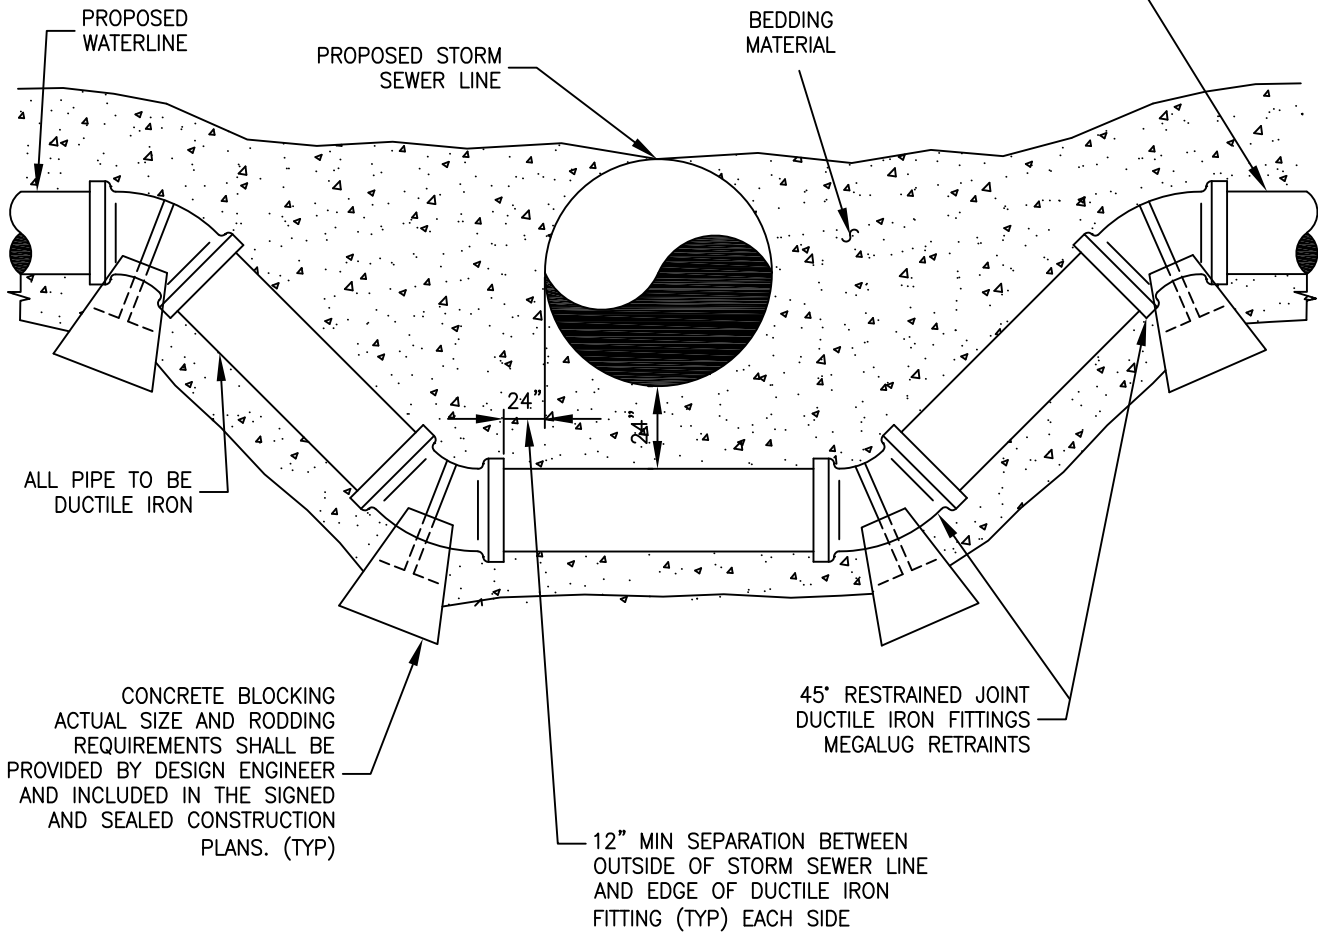

CITY OF HUTTO
 CONSTRUCTION STANDARDS AND DETAILS
WATER LINE AND STORMSEWER
LINE CROSSING - TYPE 1
 ENGINEERING & PUBLIC WORKS

DRAWING NO.	W31
UPDATED:	04/01/2019
DRAWN BY:	BB
SCALE:	N.T.S.
FILE NAME:	W31.DWG